
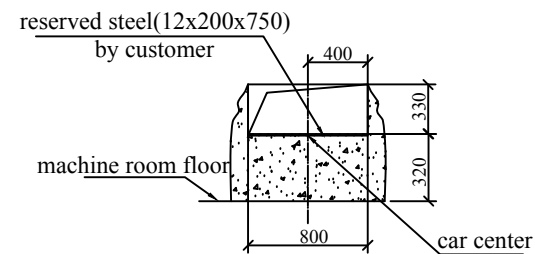
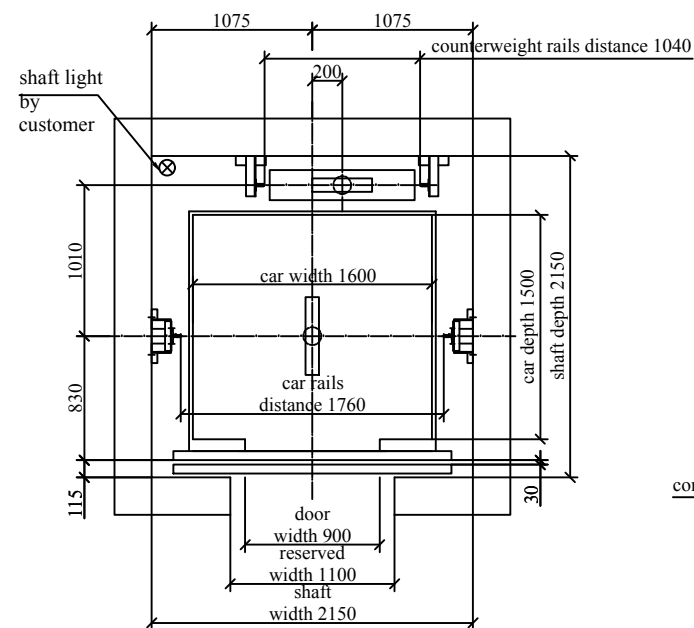



machine room layout

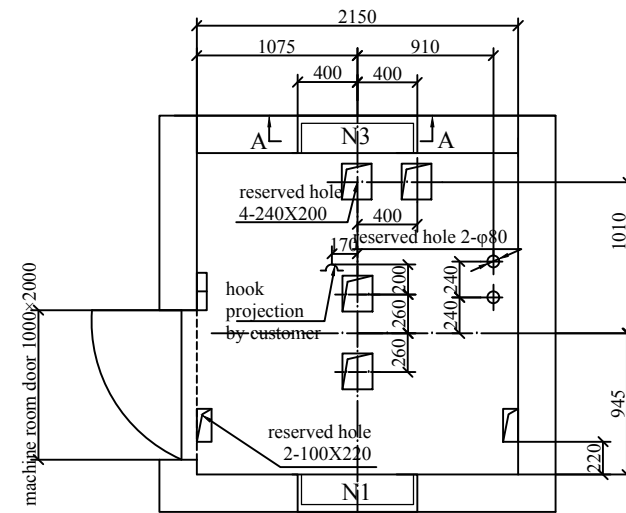

A--A section

shaft layout

machine room hole view

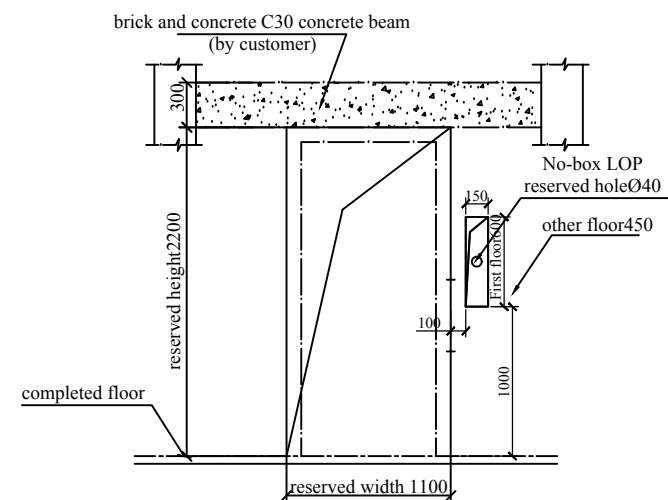

landing door hole view


contract		We agree to produce according to this drawing		
No.		Reviewer	Principal	Company
		Project		
		Company		

Specifications		
Model	TKJ1000/1.0	TKJ1000/1.5(1.75)
capacity (kg)	1000	1000
Speed (m/s)	1.0	1.5(1.75)
Person	13	13
door opening	Center opening	Center opening
traction pulley(mm)	φ400	φ400
guide pulley(mm)	φ400	φ400
car top pulley(mm)	φ520	φ520
counterweight pulley(mm)	φ400	φ400
Power(kw)	6.4	10.0(11.7)
current (A)	15.0	24.0(26.0)
car external dimension(mm)	1650(W)X1665(D)	1650(W)X1665(D)
car inside dimension(mm)	1600(W)X1500(D)	1600(W)X1500(D)
car height(mm)	2400	2400
landing door(mm)	900X2100	900X2100
min floor space(mm)	2750	2750
stop(floor)	16	24(32)
travel height(m)	55	85(100)
overhead height(mm)	≥4400	≥4500(4600)
pit depth(mm)	≥1400	≥1500(1600)
P o w e r	voltage (V)	380
	frequent (Hz)	50
	Power capacity(kVA)	9.2
		14.4(16.8)
S u p p o r t (N)	beam N1	48000
	beam N2	
	beam N3	81000
	car N4	101000
	counterweight N5	81000

Note

1. Brick and concrete shaft according to the drawing bury the steel plate in advance, plate parts please see the drawing. If not bury in advance, add beam between each floor. Guide rail support vertical distance is not over 2.0m. When the distance between two landing slits over 11m, need a safety door.
2. hoistway pit can bear the load shows in the melt pit drawing, if there's space people can reach in the pit, the other land of the pit minimum designed by 5000N/m² load, and counterweight buffer(N2) installed in the solid land(by client)
3. the shaft inside ambient temperature at +5~+40 °C
4. please meet the following requirements when you use expansion bolt to install the elevator guide rail support: a. concrete wall is solid and strong, the compressive strength not below 21Mpa b. the thickness of the concrete wall over 120mm
5. Shaft should keep dry and isolate from the water tank and flue. And it should be well-ventilated. The top of the shaft should have insulating layer and enough lighting. In cold region, it should take heating into consideration.
6. working condition for elevator: A. the altitude should not higher than 1000m. B. supply voltage: relative to rated voltage, the range should be controlled in $\pm 7\%$ C. the average max relative humidity of the elevator working place during the wettest month should be 90%. At the same time, the lowest temperature should be less than 25 degree centigrade D. there should have no corrosive and flammable air or conductive dust in the environment.
7. the shaft should keep vertical. It only allows positive deviation. The deviation of hoistway (whose total height is $\leq 30m$) is as follows $0 \sim +25mm$, for shaft total height $\leq 60m$, deviation is $0 \sim 35mm$, for shaft total height $\leq 90m$, deviation is $0 \sim 50mm$.
8. the door size is the one after decoration. So there should have a slack in the building. And doing the decoration after installing the door. The power supply of cabin are all provided by the customer.
9. If there is equipment like water pipe, the customer should negotiate with our company in advance. The entrance of the room should be clear. The width for aisle and stair to the room should not be less than 1200mm, and the slope should not higher than 45 degree. the top of the shaft should install air vent and the size should be larger then 1% of shaft horizontal section area.
10. in the shaft which contains several elevators, there should set obstacle between different moving parts. The obstacle should at least extend from the lowest spot to the height over 2.5m of the lowest floor of cabin, counterweight (or balancing weight), width should can prevent people from going one pit to the other pit (count by client)

Floor	Height(mm)	going one pit to the other pit(count by client)	
Mark	QTY	Sign	Date
Design		Confirm	
Reviewer		Date	



Schumacher elevator (Zhangjiagang) Co., Ltd.

Civil engineering guidance	
Drawing No	SMKXX1000